


# 16. Multi System

Install one system controller (SC-401-6M) for every six units. Only WHXCE56 series.

## A. Installation without a recirculation system (Standard System)

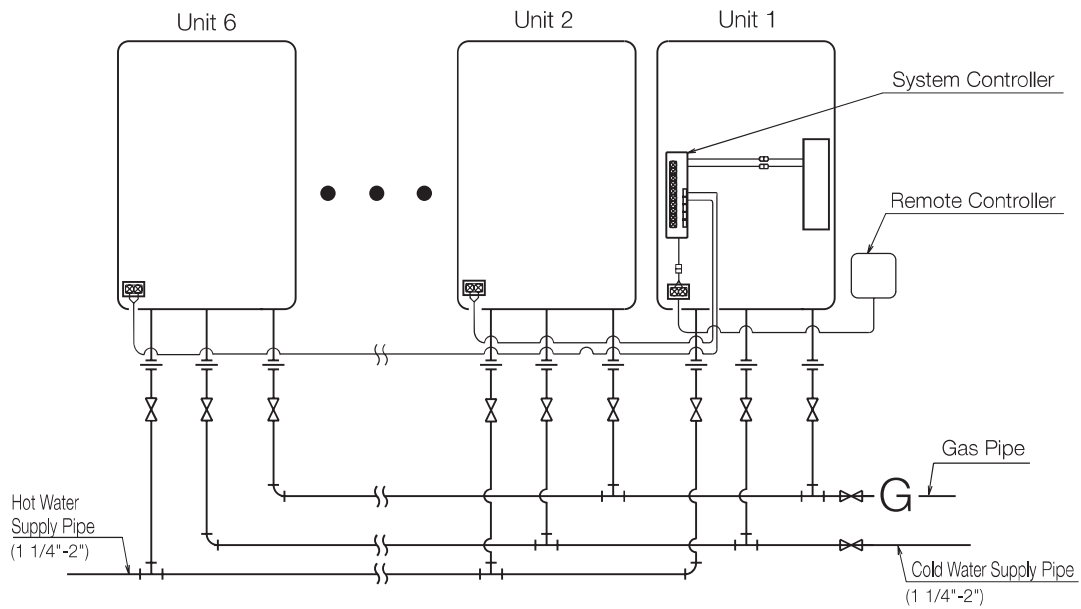

- Insulate or apply heating materials to both the cold water supply piping and the hot water supply piping to prevent freezing during cold weather and to prevent heat loss through the piping.